



MATCH LINE STA. 121+50

MATCH LINE STA. 127+00

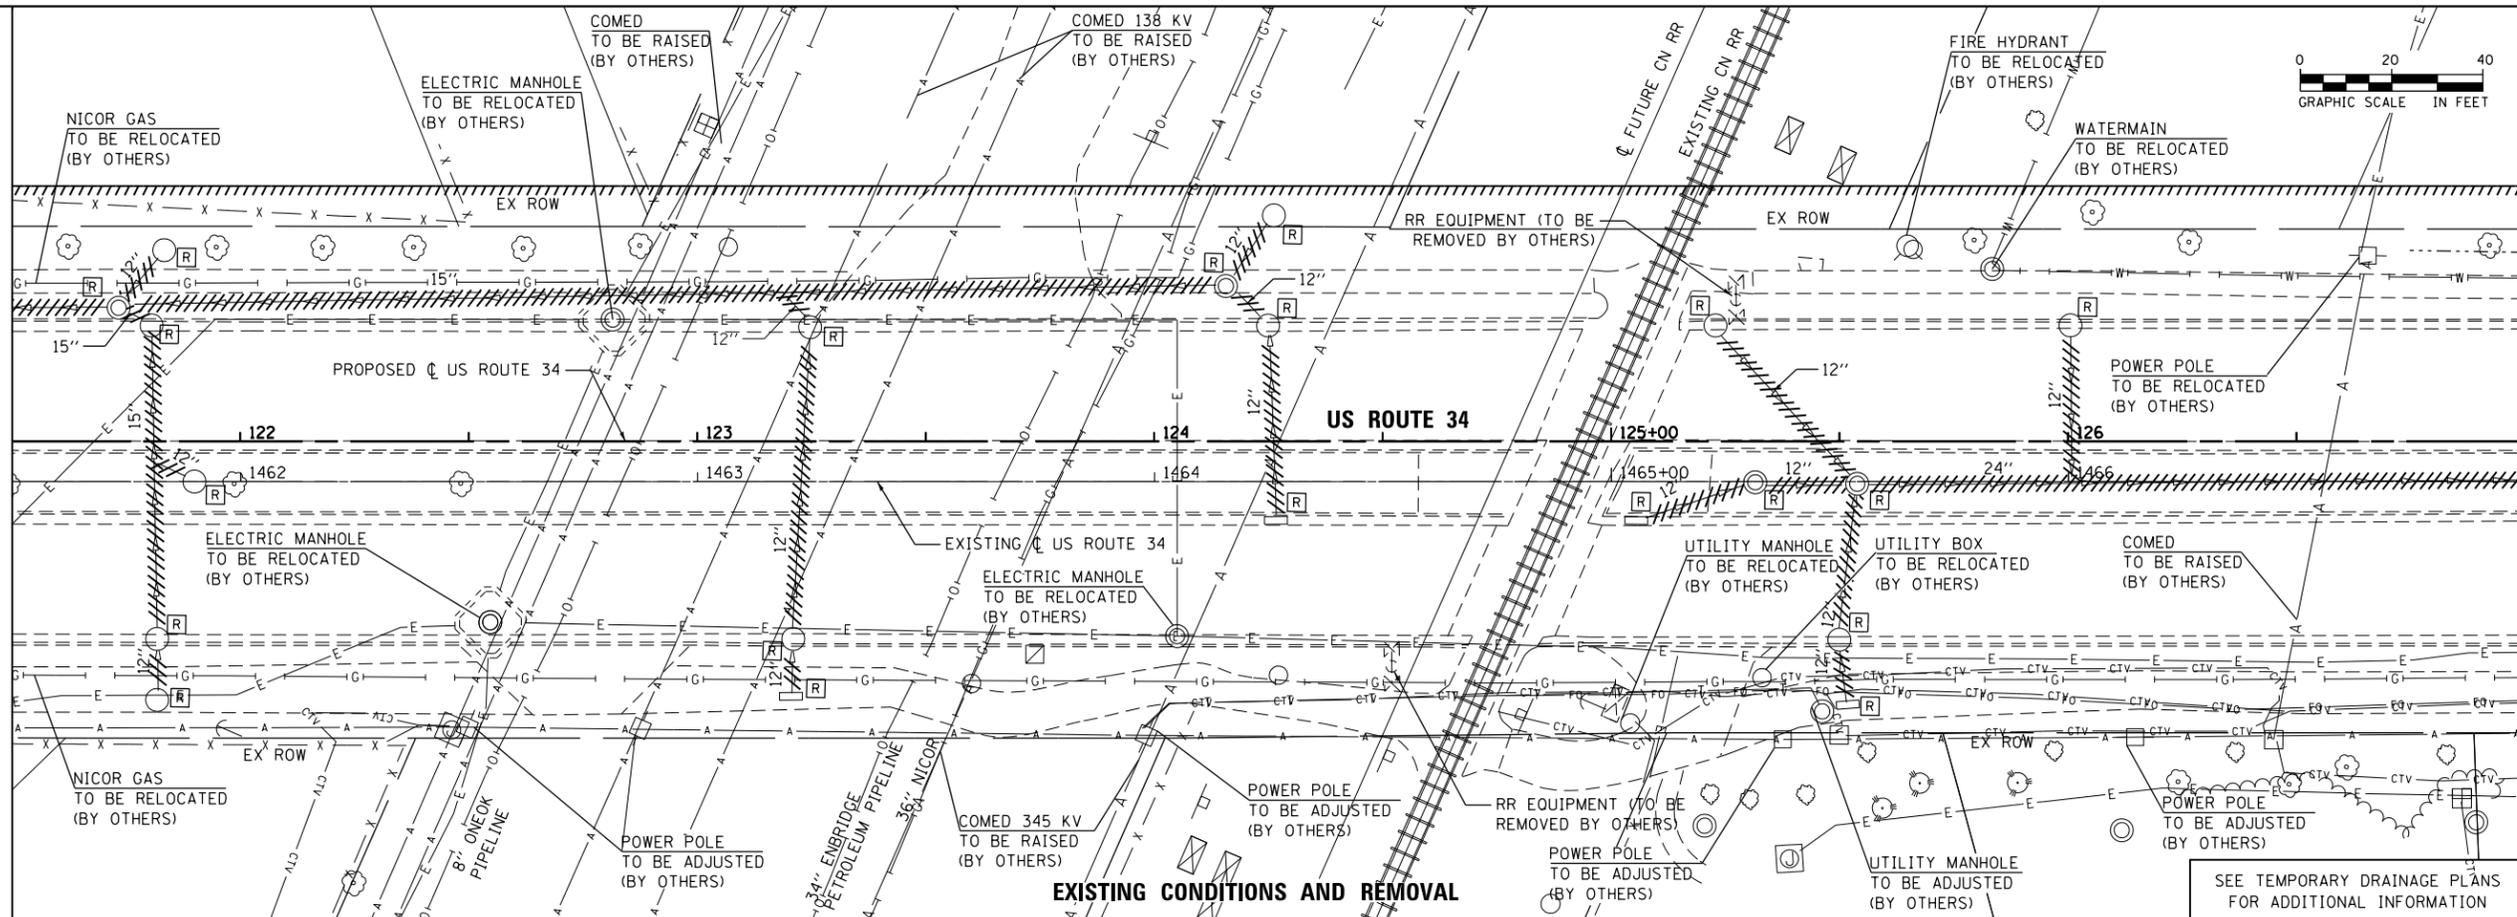

MATCH LINE STA. 121+50

MATCH LINE STA. 127+00

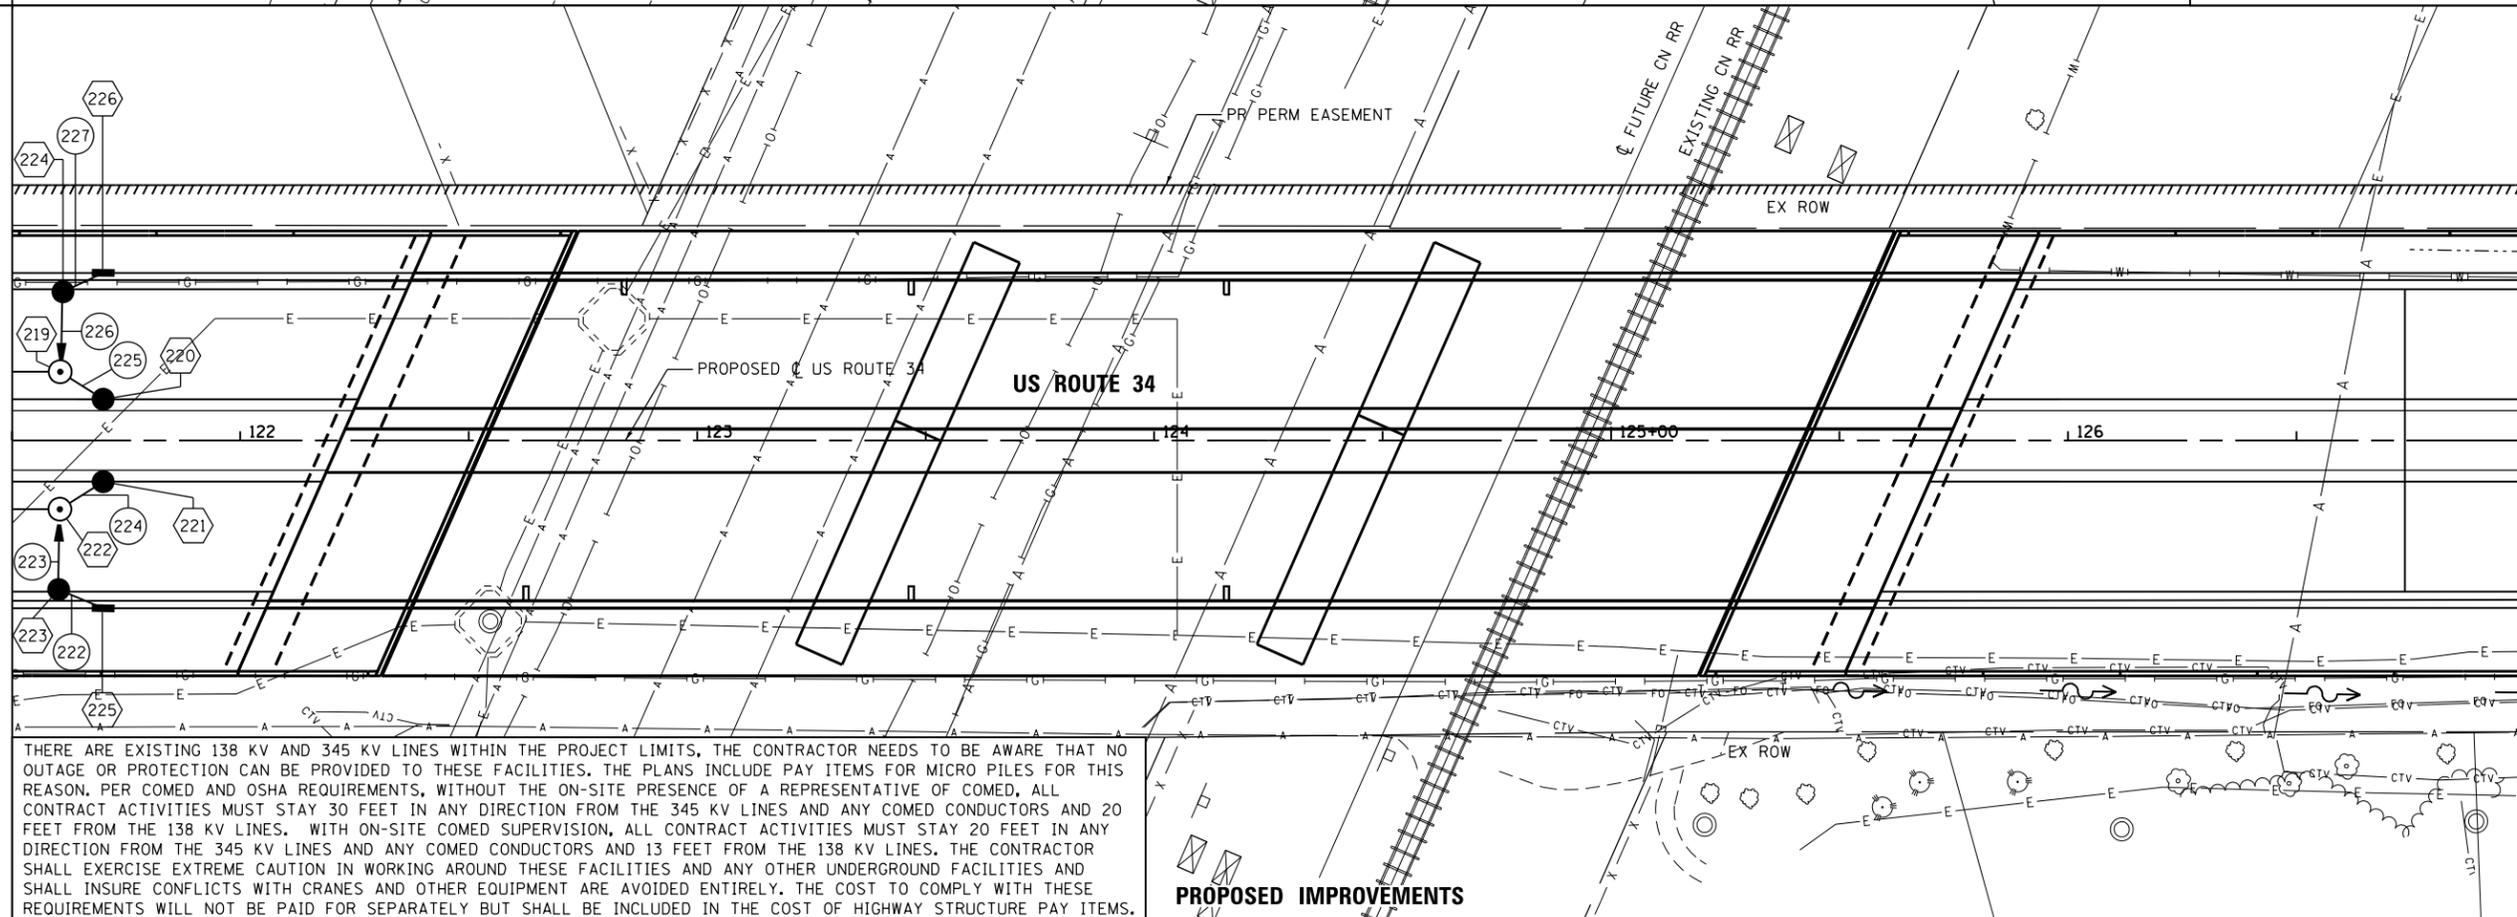

THERE ARE EXISTING 138 KV AND 345 KV LINES WITHIN THE PROJECT LIMITS, THE CONTRACTOR NEEDS TO BE AWARE THAT NO OUTAGE OR PROTECTION CAN BE PROVIDED TO THESE FACILITIES. THE PLANS INCLUDE PAY ITEMS FOR MICRO PILES FOR THIS REASON. PER COMED AND OSHA REQUIREMENTS, WITHOUT THE ON-SITE PRESENCE OF A REPRESENTATIVE OF COMED, ALL CONTRACT ACTIVITIES MUST STAY 30 FEET IN ANY DIRECTION FROM THE 345 KV LINES AND ANY COMED CONDUCTORS AND 20 FEET FROM THE 138 KV LINES. WITH ON-SITE COMED SUPERVISION, ALL CONTRACT ACTIVITIES MUST STAY 20 FEET IN ANY DIRECTION FROM THE 345 KV LINES AND ANY COMED CONDUCTORS AND 13 FEET FROM THE 138 KV LINES. THE CONTRACTOR SHALL EXERCISE EXTREME CAUTION IN WORKING AROUND THESE FACILITIES AND ANY OTHER UNDERGROUND FACILITIES AND SHALL INSURE CONFLICTS WITH CRANES AND OTHER EQUIPMENT ARE AVOIDED ENTIRELY. THE COST TO COMPLY WITH THESE REQUIREMENTS WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE COST OF HIGHWAY STRUCTURE PAY ITEMS.

FILE NAME = Q:\1001_25368367_US_34.ctb CN P:\2\Drawings\Roadway\Drainage\Utility\11616106-sht-Dr-am_005.dgn



USER NAME = URS	DESIGNED - MB	REVISED -
PLOT SCALE = 48.0000' / in.	DRAWN - KJB	REVISED -
PLOT DATE = 02/28/2014	CHECKED - SPF	REVISED -
	DATE - 02/28/2014	REVISED -

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

DRAINAGE AND UTILITY PLAN
US ROUTE 34

SCALE: 20 SHEET NO. 5 OF 8 SHEETS STA. 121+50 TO STA. 127+00

F.A.P. RTE. 311	SECTION 652-A	COUNTY DUPAGE	TOTAL SHEETS 383	SHEET NO. 96
CONTRACT NO. 60R06				
FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT				